

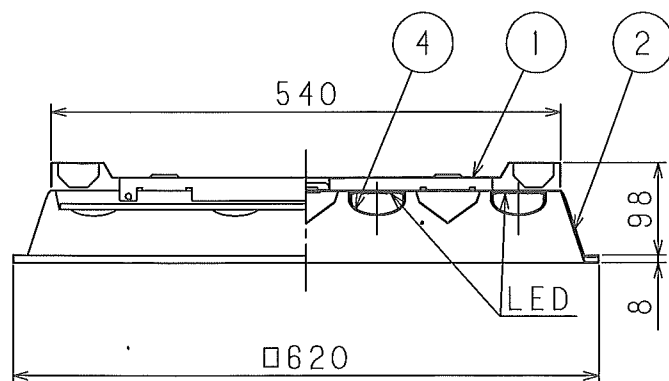
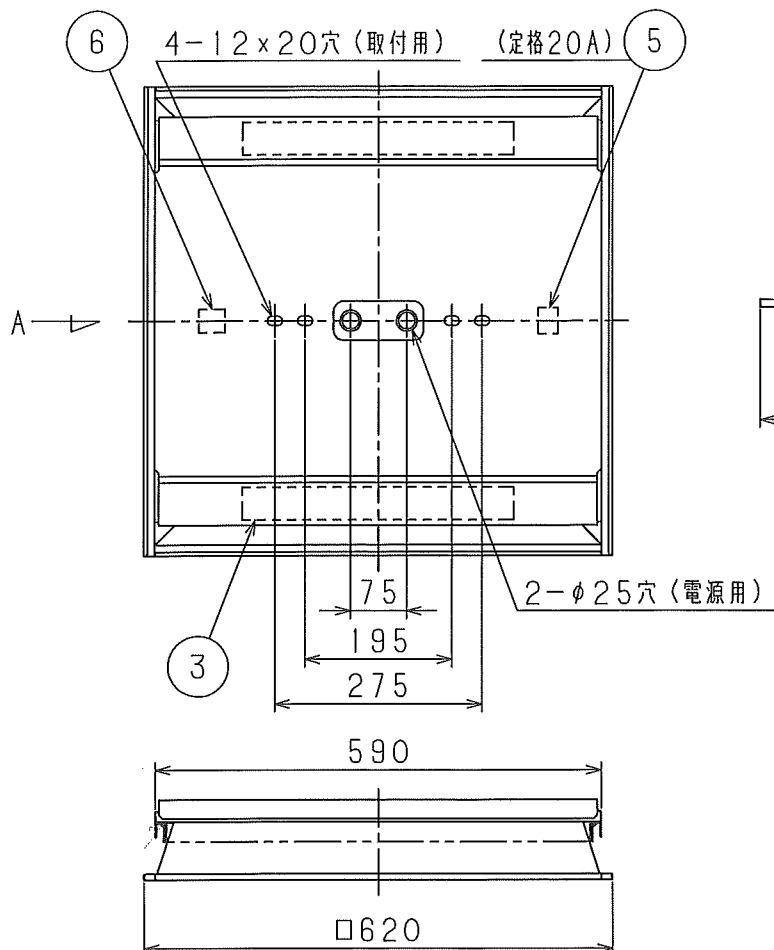


The diagram illustrates the correct installation of a fireproof safe. The safe is shown as a rectangular box labeled '器具' (Equipment). It is positioned between two sections of '断熱材' (Insulating material). The safe is placed on a base of '断熱材' and is surrounded by '断熱材' on the sides and top. The distance between the safe and the surrounding insulating material is indicated as '10cm以上' (10cm or more) on all sides. Above the safe, there is a label 'F-4' and a dimension '100'. Below the diagram is a warning sign that reads '断熱材施工不可' (Do not perform insulating material construction) with a crossed-out icon of a person using a tool on a wall.

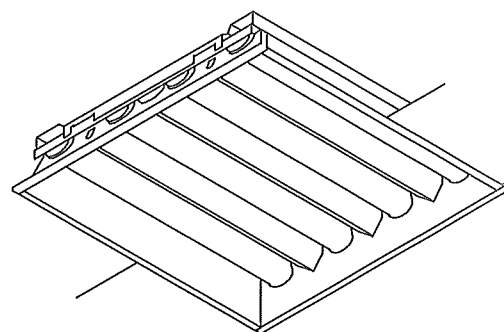

A 矢視

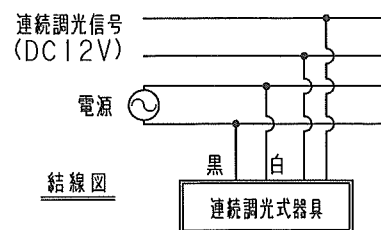

連続調光式器具

特記事項					5	電源端子台		V3
					4	LEDカバー	PC	乳白
		先方記号	電圧 (V)	数 量	3	点灯装置		
形式	LEDスクエア器具	丸山			2	反 射 板	SPC	t0.6 白色
TE45401N-JZU14	小野	6.7kg	—	—	1	本 体	SPC	t0.6
	中澤	器具質量	適合ランプ	W・数	品番	部 品 名	材質	備 考
日立アプライアンス株式会社							NT801322 △	